GETRIEBEBAU NORD

Member of the NORD DRIVESYSTEMS Group



Getriebebau NORD GmbH & Co. KG Getriebebau-Nord-Straße 1 • 22941 Bargteheide, Germany • www.nord.com

SK CU4-CAO-C

Part number: 275 271 501

CANopen® - Internal Bus Interface

The bus interface may only be installed and commissioned by qualified electricians. An electrician is a person who, because of their technical training and experience, has sufficient knowledge with regard to

- Switching on, switching off, isolating, earthing and marking power circuits and devices,
- Proper maintenance and use of protective devices in accordance with defined safety standards.

A DANGER

Danger of electric shock

The frequency inverter carries hazardous voltage for up to 5 minutes after being switched off.


 Work must not be carried out unless the frequency inverter has been disconnected from the voltage and at least 5 minutes has elapsed since the mains was switched off.

Validity of document

This document is only valid in conjunction with the operating instructions of the respective frequency inverter and the bus communication manual for this bus interface (See overview at end of document). These documents contain all of the information that is required for safe commissioning of the bus interface module and the frequency inverter.

Scope of delivery

1 x	Bus interface	SK CU4-CAO-C	
1 x	System bus cable set	grey/black	
1 x	24 VDC cable set	brown/blue	
2 x	Connecting screws	M4 x 20, cross-	
		head	



Usage area

Internal interface for connecting a decentralised frequency inverter (NORDAC *BASE*, NORDAC *FLEX*, NORDAC *LINK*) to a **CANopen** field bus. This is connected to the inverter via the system bus, and can directly access up to 4 frequency inverters. 2 digital inputs are available. The bus interface has a water-repellent coating. Reliable operation is retained even with condensation.

Technical Information / Datasheet	SK CU4-CAO-C			
CANopen Bus module	TI 275271501	V 1.3	0623	en



Technical Data

Bus interface

Temperature range	-25 °C50 °C
Temperature class	Class 3K3

Vibration resistance	3M7	
Protection class	IP20	
Supply voltage	24 V ± 20 %, ≈ 100 mA	
	Reverse polarity	
	protected	

Digital input - working range	Low: 0 V 5 V, High: 11 V 30 V	
Digital input - specific data	R_i = 8.1 k Ω , input capacity: 10 nF, response time 1 ms,	
	inputs as per EN 61131-2 type 1	

Bus specification

CANopen	Max. 1 MBit/s				
	electrical isolation 5	electrical isolation 500 V _{eff}			
Bus connection	Screw terminals				
Bus termination	via DIP switch on th	ne bus interface			
Status display	6 LEDs				
Topology	Linear bus				
Cable	twisted, shielded tw	o-conductor cable			
Cable length	depending on transmission speed:				
	Bus cable length	Resistance	Cross-section	Transfer rate	
	Up to 25 m	70 mΩ/m	≥ 0.25 mm ² , AWG23	1 Mbit/s	
	2550 m	70 mΩ/m	≥ 0.25 mm ² , AWG23	800 KBit/s	
	5080 m	< 60 mΩ/m	≥ 0.34 mm ² , AWG22	500 KBit/s	
	80230 m	< 40 mΩ/m	≥ 0.5 mm ² , AWG21	250 KBit/s	
	230480 m	< 26 mΩ/m	≥ 0.75 mm ² , AWG18	125 KBit/s	
	4801000 m	< 20 mΩ/m	≥ 1 mm², AWG	50 KBit/s	
Shield	Direct to PE				
PE connection	via PE screw cap in terminal box				

Power

Update interval for process data between bus interface and frequency inverter	≥ 5 ms ^{1, 2}
Parameter read/write access on the frequency inverter	> 20 ms ²

¹ depending on bus utilisation

 $^{^{\}rm 2}\, \text{depending}$ on the setting of the P153 min. system bus cycle parameter



Bus interface characteristics


Parametrisation	CANopen via SDO	
Addressing	via DIP switch	
Setting the baud rate	via DIP switch	
Supported CANopen profile	Communication profile DS -301	
	Drive profile DS -402	
Error Messages (Emergency Messages)	to CANopen communication profile DS-301	
Access for NORD diagnosis tool via	diagnostics socket on the device (if available) and via frequency inverter	

Installation

Installation location	In defined option slot inside the NORDAC device.
Fastening	with screw fastenings

¹⁾ With NORDAC *LINK*, this assembly must be selected when ordering. The installation is then carried out at the factory. Subsequent installation is not possible.

Installation steps

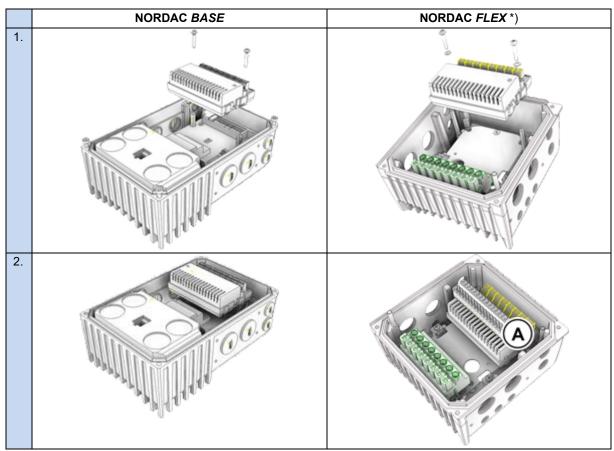

*) Before carrying out installation step 1 it may be necessary to remove the control terminal bar (A), The control terminal bar (A) must be fitted after installation step 2.


TI 275271501 - 0623 3 / 8




Connections

Connection is via the terminal strip of the bus interface.

Potential		Contact	Designation	Description
	<u>ra</u>	44	24 V	Supply potential (+24 V ±20%, 50 mA)
1	System bus level and digital inputs	40	GND	Reference potential (0 V/GND)
		C1	DIN1	Digital input 1
		C2	DIN2	Digital input 2
	bus	77	Sys +	System bus data line +
	stem	78	Sys -	System bus data line -
	Sys	40	GND	Reference potential (0 V/GND)
		45	24 V Bus	24 V supply voltage field bus
		75	CANopen+	CANopen connection 1 Receive Data + (CAN H)
		76	CANopen	CANopen connection 1 Receive Data - (CAN L)
	<u>-</u>	46	GND Bus	Bus reference potential
7	CANopen	90	SHLD	Bus shield
	CA	45	24 V Bus	Supply potential (+24 V ±20%, 50 mA)
		75	CANopen+	CANopen connection 2 Transmit Data +
		76	CANopen	CANopen connection 2 Transmit Data -
		46	GND Bus	Bus reference potential



Connection examples



bus module frequency inverter




Configuration

The bus address (node ID), the bus interface (1) and the baud rate (2) are set via the DIP switches. The DIP switch setting results in the node identifier, which is read after a "Power On" of the bus interface.

If the bus interface is the final subscriber on the CANopen field bus or the NORD system bus, the terminating resistor (3) must be activated.

DIP switch	Meaning	Department	Meaning	
8	Identifier bit 5			
7	Identifier bit 4			
6	Identifier bit 3	Addressing	Bus address (Node ID) of bus interface	
5	Identifier bit 2	Addressing		
4	Identifier bit 1			
3	Identifier bit 0			
2	Baud rate bit 1	Baud rate	Bus interface baud rate	
1	Baud rate bit 0	Daud Tale	Bus interface baud rate	
3	_		Not used	
2	CANopen	Bus terminal	Termination resistor for CANopen field bus	
1	System bus		Termination resistor for NORD system bus	



Factory settings DIP switches: OFF

1. Addressing (DIP 8 ... 3)

The setting of the node ID takes place with binary coding using DIP switches 8...3. Address area "1"..."63".

2. Baud rate (DIP 2 ... 1)

The setting of the node ID takes place with binary coding using DIP switches 2...1.

DIP switch 2	DIP switch 1	Baud rate
OFF	OFF	125 kBaud
OFF	ON	250 kBaud
ON	OFF	500 kBaud
ON	ON	1 MBaud

3. Termination resistor (DIP 3... 1)

Set DIP switch 2 to the "ON" position if the bus interface is the final subscriber on the field bus. Set DIP switch 1 to the "ON" position if the bus interface is the final subscriber on the NORD system bus.



NORDAC LINK

With the NORDAC *LINK*, the DIPP switch settings can only be adjusted at the factory. Subsequent adaptation is not possible. The configuration of the module must therefore be defined when ordering.


TI 275271501 - 0623 5 / 8



LED indicators

The operating statuses of the bus interface are visualised using LED indicators.

No.	Name	Colour	Meaning
1	CR	green	CANopen State
	CE	red	CANopen Error
2	DS	green	Device State
	DE	red	Device Error
3	D1	green	Digital input D1
	D2	green	Digital input D2



CANopen-specific LED

CR (CANopen State)	Meaning
OFF	No operating voltage, initialisation
Flashing green (1 s)	CANopen operating state "stopped"
Flashing green (0.5 s)	CANopen operating state "pre-operational"
Flashing green (0.25 s)	No other subscribers on the bus or wiring defective (only if the "CE" LED is flashing)
Green ON	CANopen operating state "operational"

CE (CANopen Error)	Meaning
OFF	No error
Flashing red	Bus warning, error counter of the CANopen controller has reached or exceeded the warning limit. → Check wiring / shielding / termination resistors.
	CANopen error → there is no physical connection to another subscriber
Red ON	CANopen controller disconnected from bus, since a serious error has occurred such as • Wiring error • Incorrect baud rate set



NORD-specific LEDs

DS	DE	Meaning	
(Device State)	(Device Error)	long flashing = 0.5 s on / 1 s off	
		short flashing = 0.25 s on / 1 s off	
OFF	OFF	Bus interface not ready, no control voltage	
ON	OFF	Bus interface ready, no error, at least one frequency inverter is communicating via the system bus	
ON	Short flashing	Bus interface ready, but	
		One or more of the connected frequency inverters has fault status	
Long flashing	OFF	Bus interface ready and at least one other subscriber is connected to the system bus, but	
		No frequency inverter on the system bus (or connection interrupted)	
		One or more system bus subscriber has an address error	
		Software incompatible (bus interface software and FI software incompatible - update required)	
Long flashing	Short flashing	System bus is in status "Bus Warning"	
	Flash interval	Communication on system bus disrupted	
	1 x - 1s pause	No other subscribers present on system bus	
		Module not inserted correctly or no connection to system bus	
		Frequency inverter has no supply voltage	
Long flashing	Short flashing	System bus is in status "Bus Off"	
	Flash interval	• The system bus 24 V power supply has been interrupted during operation	
	2 x - 1s pause		
Long flashing	Short flashing	System bus is in status "Bus Off"	
	Flash interval	The 24V voltage supply of the system bus is missing	
	3 x - 1s pause		
Long flashing	Short flashing	Bus interface error	
	Flash interval	See parameter P170	
	4 x - 1s pause		
OFF	Short flashing	System error, internal program sequence interrupted	
	Flash interval	EMC interference (observe the wiring guidelines!)	
	17 - 1s pause	Bus interface defective	

Digital input LEDs

LED (green)	Dis	olay	Meaning
D1	ON		"High" potential present at terminal "C1".
		OFF	"Low" potential present at terminal "C1".
D2	ON		"High" potential present at terminal "C2".
		OFF	"Low" potential present at terminal "C2".

TI 275271501 - 0623 7 / 8



Parameter access and diagnosis

The NORDCON software or optional control units such as the SK PAR-3H ParameterBox provide convenient access to the parameters of the bus interface and allow status information to be read out. In addition, the NORDCON *APP* – in connection with the NORDAC *ACCESS BT* Bluetooth stick – offers a practical way of mobile and wireless maintenance as well as commissioning of NORD frequency inverters.

Access is via the RJ12 diagnostics socket of the frequency inverter. The prerequisite for this is that the bus interface is connected to the frequency inverter via the system bus.

Further documentation and software (www.nord.com)

Software	Description
EDS-file	Electronic Data Sheet (Object data file)

Document	Description
<u>BU 0000</u>	Description of NORDCON software
BU 0040	Parameter box manual
<u>BU 0180</u>	Frequency inverter manual NORDAC BASE
BU 0200	Frequency inverter manual NORDAC FLEX
BU 0250	Frequency inverter manual NORDAC <i>LINK</i>

Software	Description
NORDCON Parametrisation and diagnostic software	

Document	Description
BU 2500	CANopen bus communication manual
<u>TI 275274505</u>	SK TIE4-M12-SYSM System bus connection expansion exit
<u>TI 275274506</u>	SK TIE4-M12-SYSS System bus connection expansion entrance
<u>TI 275274515</u>	SK TIE4-M12-CAO-OUT CANopen connection expansion output
TI 275274501	SK TIE4-M12-CAO CANopen connection expansion entrance